

Portable Room Air Cleaner (PRAC) Room Particle Reduction Test

December 2008



Sentry Air Systems
6999 W. Little York Rd, Suite P1
Houston, TX 77040

Test Duration: 1 hour and 30 minutes

Location: Office, 12' x 12' x 7.75'



Equipment Tested: SS-200-PRAC, SS-300-PRAC




Testing Device: Particle Scan Pro w/ logging software



SS-200-PRAC Results

Pre-Test Particle Count: 741,600

Particle count one hour and 30 minutes later: 151,200

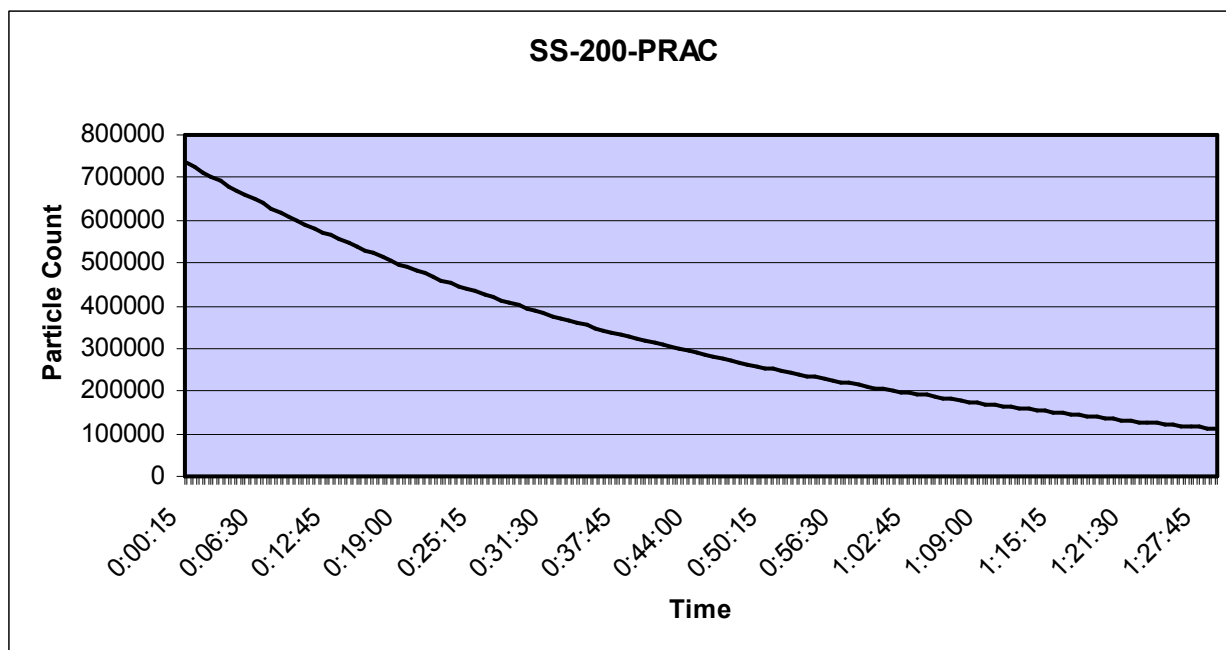

SS-300-PRAC Results

Pre-Test Particle Count: 927,600

Particle count one hour and 30 minutes later: 39,600

